

Figure 1 below shows the thermostat connections to sensor, mains and outputs.

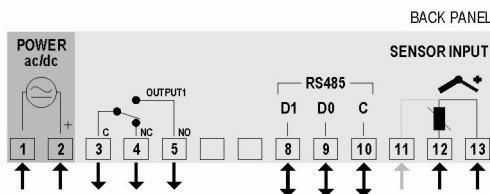


Figure 1 – N321 terminals

The N321 is a digital electronic thermostat for heating and cooling applications. It is available with NTC thermistor input sensor, Pt100, Pt1000 or J/K/T type thermocouple. Sensor offset correction is provided. The output can be used as control or alarm.

The features of a particular model (input sensor type, sensor range, mains supply, etc) are identified by the label placed on the thermostat body.

SPECIFICATIONS

INPUT SENSOR: The input sensor type can be chosen from the 4 options below (specified when placing the order):

- **NTC Thermistor**, 10 kΩ @ 25 °C; range: -50 to 120 °C (-58 to 248 °F); Accuracy: 1,0 °C (1,1 °F), with original sensor; Sensor interchangeability: 1 °C (1.35 °F). This error can be compensated by the **offset** parameter in the thermostat.
- **Pt100 (α= 385)**; Range: -50 to 300 °C (-58 to 572 °F); Accuracy: 0,7 °C (1.3 °F); IEC-751.
- **Pt1000 (α= 385)**; Range: -200 to 530 °C (-328 to 986 °F); Accuracy: 0,7 °C (1.3 °F);
- **J, K or T thermocouple** (IEC-584):
 - **Type J:** Range: 0 to 600 °C (32 to 1112 °F); Accuracy: 3 °C (5.4 °F);
 - **Type K:** Range: -50 to 1000 °C (-58 to 1832 °F); Accuracy: 3 °C (5.4 °F);
 - **Type T:** Range: -50 to 400 °C (-58 to 752 °F); Accuracy: 3 °C (5.4 °F);

Note: In the thermostat with NTC input, a 3 m-sensor cable is bundled with the instrument. The cable can be extended up to 200 m.

WARM-UP: 15 minutes

MEASUREMENT RESOLUTION:

from -19.9° to 199.9° display units with NTC, Pt100 and Pt1000: 0.1
 elsewhere: 1

OUTPUT1: Relay SPDT; 1 HP 250 Vac / 1/3 HP 125 Vac (10 A Resistive)

POWER SUPPLY: 100-240 Vac (± 10 %) or 24 Vdc/ac (12-30 Vdc/ac)
 Mains frequency: 50-60 Hz. Power consumption: 5 VA
 Caution: check the power supply specification before energizing the thermostat.

DIMENSIONS: Width x Height x Depth: 74 x 32 x 75 mm
 Panel cut-out: 70 x 29 mm; Weight: 100 g

ENVIRONMENT: Operating temperature: 0 to 40 °C (32 to 122 °F)
 Storage temperature: -20 to 60 °C (-4 to 140 °F)
 Relative humidity: 20 to 85 % non condensing

CASE: Polycarbonate UL94 V-2; Protection: Front panel: IP65, Box: IP42
 Suitable wiring: Up to 4,0 mm²

RS-485 digital communication; RTU MODBUS protocol (optional)

Pt100 with 3 conductors: Terminals 11, 12 and 13 must have the same wire resistance for proper cable length compensation. For 2 wire Pt100, short circuit terminals 11 and 13.

OPERATION

The thermostat requires the internal parameters to be configured according to the intended use for the instrument. The parameters are organized in 4 groups or levels:

Level	Function
0	Temperature measurement
1	Setpoint Adjustment
2	Configuration
3	Calibration

Upon power-up, the N321 display shows for 1 second its firmware version. This information is useful when consulting the factory.

Then, the temperature measured by the sensor is shown on the display. This is the parameter level 0 (temperature measurement level).

To access level 1, press **P** for 1 second until the "**SP**" message shows up. Pressing **P** again to go back to level 0.

To access level 2 of parameters, press **P** for 2 seconds until the "**Unt**" message is shown. Release the **P** key to remain in this level. Each new pressing on the **P** key will advance to the next parameter in the level. At the end of the level, the thermostat returns to the first level (0). Use the **▲** and **▼** keys to alter a parameter value.

Notes: 1 A parameter configuration is saved when the **P** key is pressed to advance to the next parameter in the cycle. The configuration is stored in a non-volatile memory, retaining its value when the thermostat is de-energized.

2 If no keyboard activity is detected for over 20 seconds, the thermostat saves the current parameter value and returns to the measurement level.

Level 1 –Setpoint Adjustment

In this level only the Setpoint (**SP**) parameter is available, alternating the name with its respective value. Adjust the desired temperature for setpoint by clicking on the **▲** and **▼** keys.

SP Set Point	Temperature adjustment for control OUTPUT 1. SP value is limited to the values programmed in SPL and SPH in the programming level (Parameter configuration, level 2).
------------------------	--

Level 2 – Configuration - Parameters configuration Level

Contains the configuration parameters to be defined by the user, according to the system's requirements. Use **▲** and **▼** keys to set the value. The display alternates the parameter name and respective value.

Unt	Temperature Unit - Selects display indication for degrees Celsius or Fahrenheit. 0 - Temperature in degrees Celsius 1 - Temperature in degrees Fahrenheit
tYP	Input Type - Selects the input sensor type to be connected to the controller. Available only for thermocouple models, allowing selection of types J, K and T. 0 - Thermocouple type J 1 - Thermocouple type K 2 - Thermocouple type T
oFS	Sensor Offset - Offset value to be added to the measured temperature to compensate sensor error.
SPL	SP Low Limit - Lower range for SP . SPL must be programmed with a lower value than SPH .
SPH	SP High Limit - Upper range for SP . SPH must be greater than SPL .
HY 1	OUTPUT 1 Hysteresis: defines the differential range between the temperature value at which the OUTPUT 1 is turned on and the value at which it is turned off. In degrees.
Rct	Control action for OUTPUT 1 : 0 Reverse: For heating applications. Outputs turn on when temperature is lower than SP. 1 Direct: For cooling applications. Output turns on when temperature is above SP.
oFt Off time	Off time - Defines the minimum off time for control OUTPUT 1. Once OUTPUT 1 is turned off, it remains so for at least the time programmed in oFt . For thermocouple inputs this parameter is not available. This parameter is intended for refrigeration systems where longer compressor life is desired. For heating systems, program oFt to zero. Value in seconds, 0 to 999 s.
oNt on time	On time - Defines the minimum on time for control OUTPUT 1. Once turned on, OUTPUT 1 remains so for at least the time programmed in oNt . For thermocouple inputs this parameter is not available. This parameter is intended for refrigeration systems where increased compressor life is desired. For heating systems, program oNt to zero. Value in seconds, 0 to 999 s.
dLY Delay1	Delay time to start control. Upon power-on, control OUTPUT 1 is kept off until the time programmed in dLY is elapsed. Its usage is intended to prevent multiple compressors to start simultaneously after the turn-on of a system with several thermostats. Value in seconds, 0 to 250 s.
Raddr Address	Address - Thermostats with the optional RS485 Modbus RTU communication interface have the Raddr parameter at the Configuration level. Set a unique Modbus address for each equipment connected to the network. Address range is from 1 to 247.

Level 3 – Calibration level

The thermostat is factory calibrated. The following parameters should be accessed only by experienced personnel. To enter this cycle, the **P** key must be kept pressed for 4 seconds.

Don't press the **▲** and **▼** keys if you are not sure of the calibration procedures. Just press the **P** key a few times until the temperature measurement level is reached again.

PRS	Password - Enter the correct password to unlock write operations for the parameters in the following levels.
CAL	Calibration low - Offset value of the input. It adjusts the lower measurement range of the sensor.
CAH	Calibration High - Gain calibration. It adjusts the upper measurement range of the sensor.
CJL	Cold Junction Offset calibration - This parameter is available only for thermocouple.
FAC	Factory Calibration - Restores factory calibration parameters. Change from 0 to 1 to restore the calibration parameters with factory values.
PrL	Protection - Defines the levels of parameters that will be password protected. See "Configuration Protection" for details.
PAC	Password Change - Allows changing the current password to a new one. Values from 1 to 999 are allowed.
Sn2	Serial number - First part of the thermostat electronic serial number.
Sn1	Serial number - Second part of the thermostat electronic serial number.
Sn0	Serial number - Third part of the thermostat electronic serial number.

WORKING WITH THE THERMOSTAT

The N321 energizes the output relay such as to maintain the process temperature on the setpoint value defined by the user. The output status led **P1** signals when the control output is on.



Figure 2 – Frontal Panel

CONFIGURATION PROTECTION

A protection system to avoid unwanted changes to the thermostat parameters is implemented. The level of protection can be selected from partial to full. The following parameters are part of the protection system:

- PRS** When this parameter is presented, the correct password should be entered to allow changes of parameters in the following levels.
- PrL** Defines the level of parameters that will be password protected:
- 1 - Only calibration level is protected (factory configuration);
 - 2 - Calibration and Configuration levels are protected;
 - 3 - All levels are protected - calibration, Configuration and setpoints.
- PAC** Parameter for definition of a new password. Since it is located in the calibration level, can only be changed by a user that knows the current password. Valid passwords are in the range 1 to 999.

CONFIGURATION PROTECTION USAGE

PRS parameter is displayed before entering a protected level. If the correct password is entered, parameters in all following levels can be changed. If wrong or no password is entered, parameters in the following levels will be read only.

Important notes:

- 1- After five consecutive attempts to enter a wrong password, new tentative will be blocked for the next 10 minutes. If the current valid password is unknown, the master password can be used only to define a new password for the thermostat.
- 2 - The password for a brand new device is 111.

MASTER PASSWORD

The master password allows user to define a new password for the thermostat, even if the current password is unknown. The master password is based in the serial number of the thermostat, and calculated as following:

[1] + [higher digit of SN2] + [higher digit of SN1] + [higher digit of SN0]

for example the master password for the device with serial number 987123465 is: **1 9 3 6**

as follows: **1 + Sn2= 987; Sn1= 123; Sn0= 465 = 1 + 9 + 3 + 6**

How to use the master password:

- 1- Enter the master password value at **PRS** prompt.
- 2- Go to **PAC** parameter and enter the new password, which must not be zero (0).
- 3- Now you can use this new password to access all thermostat parameters with modify rights.

ERROR MESSAGES

Sensor measurement errors force the thermostat outputs to be turned off. The cause for these errors may have origin in a bad connection, sensor defect (cable or element) or system temperature outside the sensor working range. The display signs related to measurement errors are shown below:

	Measured temperature exceeded maximum allowed range for the sensor. Broken Pt1000 or T/C . Short circuited NTC sensor.
	Measured temperature is below minimum measurement range of the sensor. Short circuited Pt1000 or T/C . Broken NTC .

ELECTRICAL WIRING

It is important to follow the recommendations below:

- Signal wires should be installed in grounded conduits and away from power or contactor wires.
- The instrument should have its own power supply wires that should not be shared with electrical motors, coils, contactors, etc.
- Installing RC filters (47 R and 100 nF, series combination) is strongly recommended at contactor coils or any other inductors.
- System failure should always be taken into account when designing a control panel to avoid irreversible damage to equipment or people.



UK / Europe Office
 Tel: +44 (0)8700 434040
 Fax: +44 (0)8700 434045
info@omniinstruments.co.uk
www.omniinstruments.co.uk

Australia / Asia Pacific Office
 Tel +61 (0)282 442 363
 Fax +61 (0)294 751 278
info@omniinstruments.com.au
www.omniinstruments.com.au

USA / Canada Office
 Tel +1-866-849-3441
 Fax +1-866-628-8055
info@omniinstruments.net
www.omniinstruments.net